



102 mm (4") Terminators
4 per side

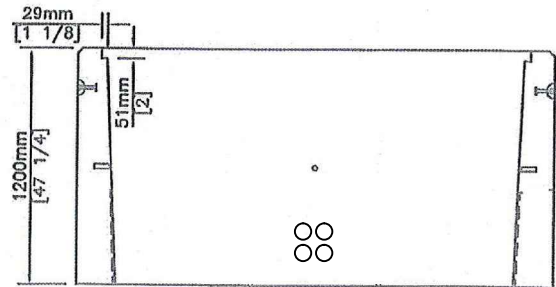

NOTE:

- 1 - CONCRETE, MINIMUM 28 DAYS STRENGTH TO BE 30Mpa --TYPE 50
- 2 - REINFORCEMENT TO BE WELDED WIRE FABRIC TO CSA G30.3-1983
- 3 - SUFFICIENT LAP STRENGTH FOR REINFORCEMENT SHOULD BE PROVIDED TO ENSURE CONTINUITY OF REINFORCEMENT.
- 4 - MINIMUM CONCRETE COVER FOR REINFORCEMENT
A)30mm FOR OUTSIDE FACE OF BOX PAD
B)20mm FOR INSIDE FACE OF BOX PAD
- 5 - MASS: 8935 Lbs / 4060 Kg
- 6 - BASE IS SIZED TO ACCOMODATE 15KV -- 25KV SWITCHGEAR
- 7 - UNLESS OTHERWISE INDICATED, ALL DIMENSIONS ARE IN MILLIMETRES
- 8 - LIFTING ANCHOR IS 2.5 TON 3 3/8" LENGTH UNLIFTER

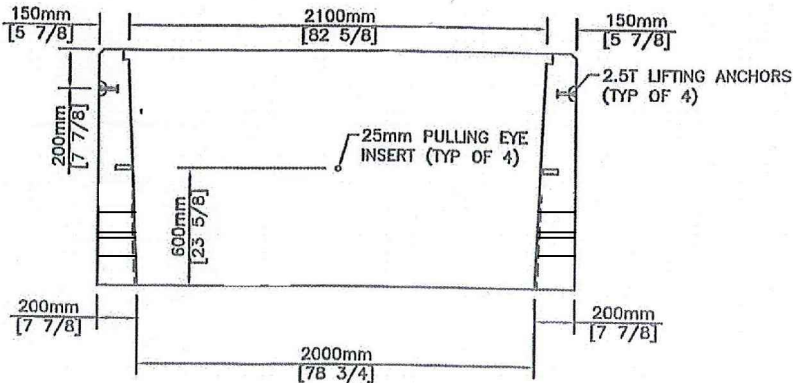

TEL: 250-495-7556
socp@socp.ca
www.socp.ca

Box 419, 11602 - 115 st Osoyoos, BC V0H 1V0

FAX: 250-495-3556

1595 Fortis Switch Cubicle Base c/w Terminators

Product #

1129